Location of QTemitter

1 E2.1A LIGHTING PLAN - FIRST FLOOR - PART A
SCALE: 1/8"=1'-0"

GENERAL NOTES:

1. ALL 2'x4' FIXTURES SHALL BE TYPE "AD" UNLESS OTHERWISE NOTED. PROVIDE TWO SWITCHLEG CONDUCTORS TO DUAL INPUT BALLAST AT FIXTURE AS INDICATED BY OR
2. ALL DOWNLIGHTS TO BE TYPE "D" UNLESS OTHERWISE NOTED. WHERE SHOWN IN SPACE WITH DIMMER, ALL DOWNLIGHTS TO BE CONTROLLED VIA DIMMER SWITCH ONLY.
3. OCCUPANCY SENSORS SHALL CONTROL ALL FIXTURES WITHIN SAME ROOM/CORRIDOR AS SENSOR. ALL SENSORS TO BE LINE VOLTAGE SENSORS ONLY. SEE MANUFACTUER'S INSTALLATION GUIDELINES FOR LOCATIONS WHERE MULTIPLE SENSORS CONTROL SAME LIGHT FIXTURE CIRCUIT/LOAD.
4. PROVIDE UNSWITCHED PHASE CONDUCTOR(HOT) TO ALL EXIT SIGNS AND TYPE "E" FIXTURES, DO NOT ROUTE THROUGH RELAY PANEL OR ON LOAD SIDE OF EMERGENCY RELAY.
5. LV MINIMUM 4-BUTTON LOW VOLTAGE LIGHTING CONTROL SWITCH. PROVIDE LOW VOLTAGE CABLING TO RELAY PANEL LOCATED ON THIS FLOOR. SEE SCHEDULE SHEET FOR BUTTON OPERATION INSTALLATION REQUIREMENTS.
6. ROUTE NEUTRAL CONDUCTOR TO ALL WALL MOUNTED LINE VOLTAGE LIGHT CONTROL DEVICES.

KEYED NOTES:

1. "NORMAL" LIGHTING SWITCHED, EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 1/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
2. "BYPASS / OVERRIDE", EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 2/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
3. "DUAL LEVEL - NORMAL" LIGHTING SWITCHED, EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 3/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
4. HOMERUN FOR CIRCUIT SERVING THIS AREA. PROVIDE CONDUCTOR WIRING TO ALL SPACES WITH LIGHT FIXTURES OF MATCHING CIRCUIT HOMERUN DESIGNATION. PROVIDE UNWITCHED CONDUCTOR FOR INDEPENDENT SPACE CONTROL BY DEVICE AS SHOWN IN EACH SPACE.
5. ROUTE TO CIRCUIT AS SHOWN VIA "BYPASS / OVERRIDE", EMERGENCY LIGHTING CONTROL UNIT TO BE LOCATED AT PANEL, EMERGENCY LIGHTING CONTROL UNIT TO BE OPERATED BY PANEL "RPS. SEE DETAIL 4/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
6. ROUTE CIRCUIT TO LIGHTING CONTROLLER UNIT LOCATED IN EQUIPMENT CLOSET. SEE E3.1A FOR LOCATION. SEE CONTROLLER SCHEDULE BELOW FOR OPERATION AND CONTROL REQUIRMENTS.
7. SINGLE GANG BOX AT 46" AFF FOR 4-BUTTON LOW VOLTAGE ENTRY STATION BUTTON WITH RAISE/LOWER CAPABILITIES. ENTRY STATION TO BE ILLUMIN "INEO #CLS-4TSB-RL-W" SERIES. SEE CONTROLLER SCHEDULE BELOW FOR OPERATION AND CONTROL REQUIRMENTS.
8. CONNECT TO LOAD SIDE OF GFCI OULET IN SPACE. SEE SHEET E3.1A FOR CONTINUATION.



2 E2.1A DETAIL - TYPICAL SPACE LIGHTING
SCALE: 1/8"=1'-0"

COURTROOM CONTROLLER SCHEDULE

TERMINAL NO. & TYPE		LIGHTING CONTROLLED (AREA)
1	DIMMER	TYPE "D" DOWNLIGHTS (EMERGENCY)
2	DIMMER	TYPE "D" DOWNLIGHTS
3	ON / OFF	TYPE "A2" TROFFERS COURT (EMERGENCY)
4	ON / OFF	TYPE "A2" TROFFERS COURT
5	ON / OFF	TYPE "A2" TROFFERS SEATING (EMERGENCY)
6	ON / OFF	TYPE "A2" TROFFERS SEATING
7	DIMMER	TYPE "ND" PENDANTS
8 - 12		SPARE

REMARKS:
–



KEY PLAN

ELECTRICAL DESIGN CONSULTANTS INC.
ELECTRICAL ENGINEERS
1201 BROAD ST., SUITE 1-A
AUGUSTA, GA 30901
PH: (706) 724-3551
FAX: (706) 724-8507
EDC PROJECT #: 10051
drawings@edcaugusta.com
http://www.edcaugusta.com

SEALS

SOUTH CAROLINA REGISTERED PROFESSIONAL ENGINEER M. PAULK III 12-5-12

SOUTH CAROLINA ELECTRICAL DESIGN CONSULTANTS, INC. No. C01139 CERTIFICATE OF AUTHORIZATION

AIKEN COUNTY GOVERNMENT COMPLEX

AIKEN, SOUTH CAROLINA

REVISIONS:

NO.	DATE	DESCRIPTION	BY
1	2.21.12	PRELIMINARY REVIEW PACKAGE	EDC
2	5.1.12	DESIGN DEVELOPMENT PACKAGE	EDC
3.	7.20.12	50% CONSTRUCTION DOCUMENTS	EDC
4.			
5.	8.27.12	ISSUED FOR CONSTRUCTION	EDC
6.	11.5.12	CODE AND DEPARTMENT REVIEW COMMENTS	EDC
7.	3.15.13	DEPARTMENT REVIEW CHANGES	EDC

PRINCIPAL IN CHARGE: M. Paulk III
PROJECT MANAGER: K. Holt
DRAWN BY:

SHEET TITLE:
LIGHTING PLAN - FIRST FLOOR - PART A

SHEET NO. E2.1A

PROJ. NO. 10033.02

ALL DRAWINGS, SPECIFICATIONS AND COPIES THEREOF FURNISHED BY MCMILLAN PAZDAN SMITH ARCHITECTURE ARE AND SHALL REMAIN THE PROPERTY OF MCMILLAN PAZDAN SMITH ARCHITECTURE. THESE MATERIALS ARE TO BE USED ONLY WITH RESPECT TO THIS PROJECT AND NOT TO BE USED WITH ANY OTHER PROJECT, WITH THE EXCEPTION OF ONE CONTRACT SET FOR EACH PARTY TO THE CONTRACT. SUCH DOCUMENTS ARE TO BE RETURNED OR DESTROYED ACCORDING TO THE TERMS OF THE CONTRACT. THESE MATERIALS MAY NOT BE REPRODUCED, PUBLISHED OR DISPLAYED WITHOUT THE WRITTEN PERMISSION OF MCMILLAN PAZDAN SMITH ARCHITECTURE. © 2012 MCMILLAN PAZDAN SMITH ARCHITECTURE - ALL RIGHTS RESERVED.

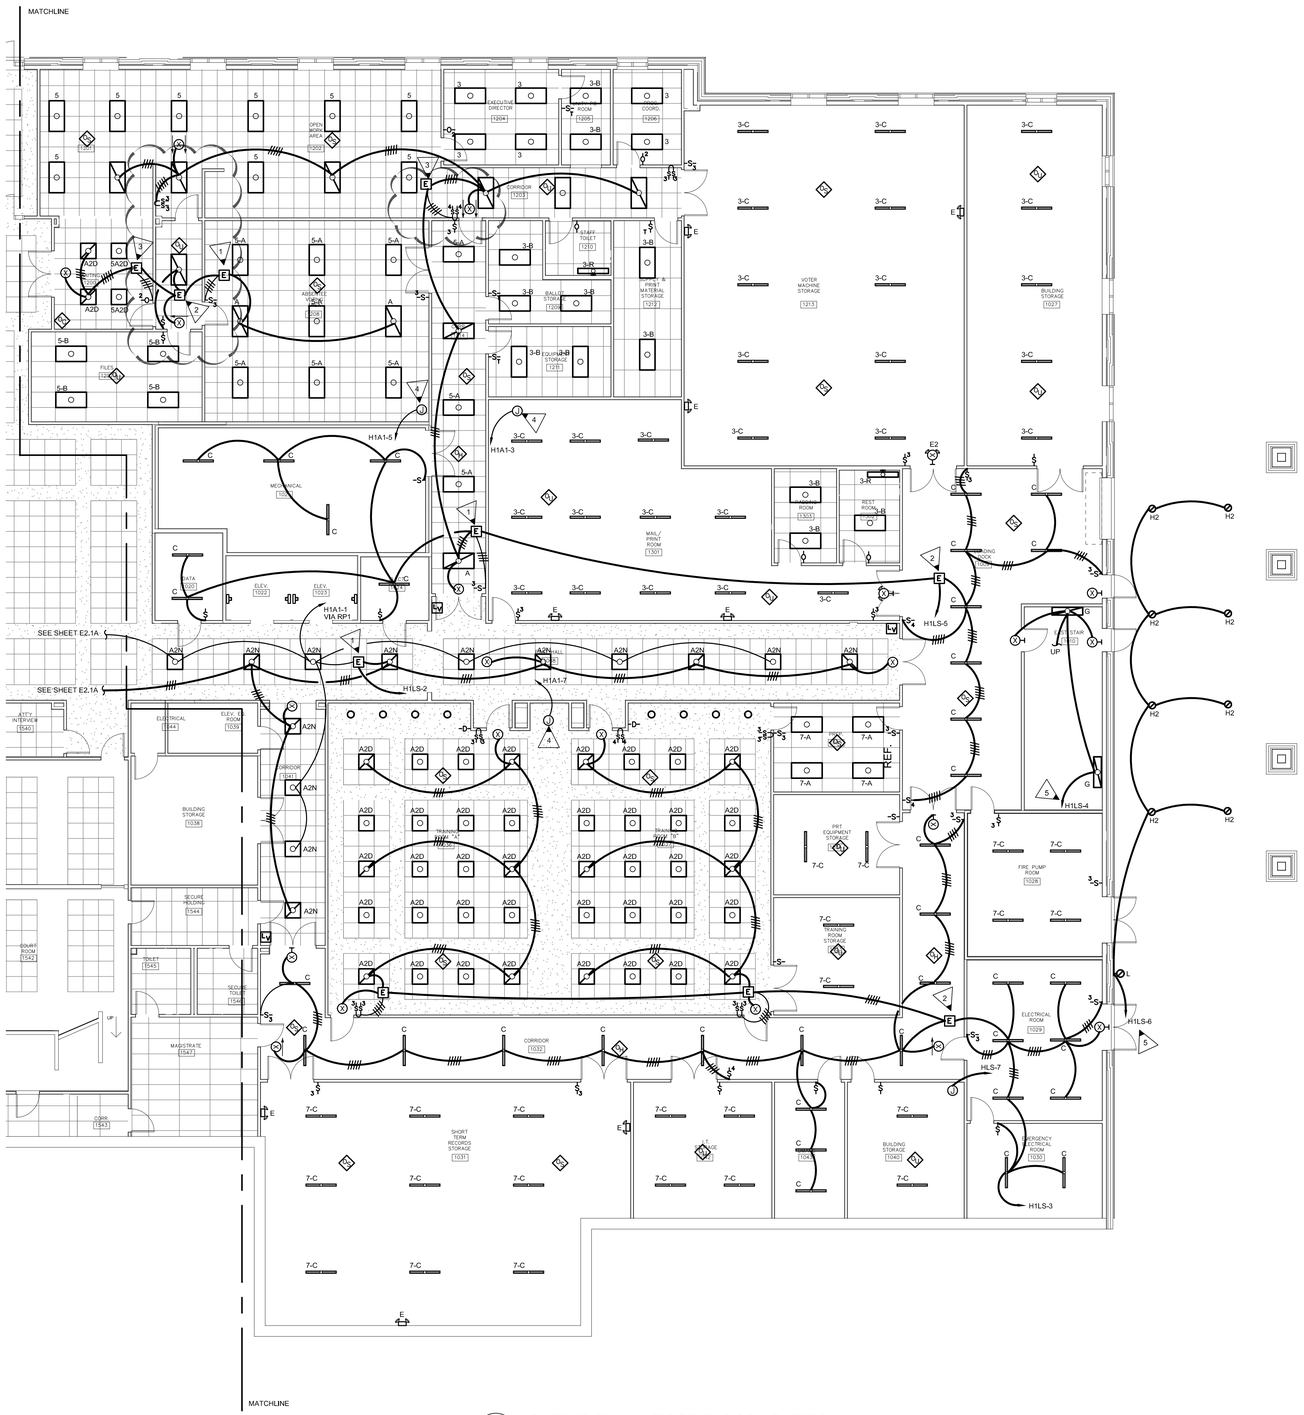

1 LIGHTING PLAN - FIRST FLOOR - PART B
E2.1B SCALE: 1/8"=1'-0"

GENERAL NOTES:

1. ALL 2'x4' FIXTURES SHALL BE TYPE "AD" UNLESS OTHERWISE NOTED. PROVIDE TWO SWITCHLEG CONDUCTORS TO DUAL INPUT BALLAST AT FIXTURE AS INDICATED BY OR
2. ALL DOWNLIGHTS TO BE TYPE "D" UNLESS OTHERWISE NOTED. WHERE SHOWN IN SPACE WITH DIMMER, ALL DOWNLIGHTS TO BE CONTROLLED VIA DIMMER SWITCH ONLY.
3. OCCUPANCY SENSORS SHALL CONTROL ALL FIXTURES WITHIN SAME ROOM/CORRIDOR AS SENSOR. ALL SENSORS TO BE LINE VOLTAGE SENSORS ONLY. SEE MANUFACTUER'S INSTALLATION GUIDELINES FOR LOCATIONS WHERE MULTIPLE SENSORS CONTROL SAME LIGHT FIXTURE CIRCUIT/LOAD.
4. PROVIDE UNSWITCHED PHASE CONDUCTOR(HOT) TO ALL EXIT SIGNS AND TYPE "E" FIXTURES. DO NOT ROUTE THROUGH RELAY PANEL OR ON LOAD SIDE OF EMERGENCY RELAY.
5. LV MINIMUM 4-BUTTON LOW VOLTAGE LIGHTING CONTROL SWITCH. PROVIDE LOW VOTLAGE CABLIG TO RELAY PANEL LOCATED ON THIS FLOOR. SEE SCHEDULE SHEET FOR BUTTON OPERATION INSTALLATION REQUIREMENTS

KEYED NOTES:

1. "NORMAL" LIGHTING SWITCHED, EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 1/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
2. "BYPASS / OVERRIDE", EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 2/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
3. "DUAL LEVEL - NORMAL" LIGHTING SWITCHED, EMERGENCY LIGHTING CONTROL UNITS. SEE DETAIL 3/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
4. HOMERUN FOR CIRCUIT SERVING THIS AREA. PROVIDE CONDUCTOR WIRING TO ALL SPACES WITH LIGHT FIXTURES OF MATCHING CIRCUIT HOMERUN DESIGNATION. PROVIDE UNWITCHED CONDUCTOR FOR INDEPENDENT SPACE CONTROL BY DEVICE AS SHOWN IN EACH SPACE.
5. ROUTE TO CIRCUIT AS SHOWN VIA "BYPASS / OVERRIDE", EMERGENCY LIGHTING CONTROL UNIT TO BE LOCATED AT PANEL. EMERGENCY LIGHTING CONTROL UNIT TO BE OPERATED BY INPUT FROM PANEL "RPS." SEE DETAIL 4/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.



ELECTRICAL DESIGN CONSULTANTS INC.
ELECTRICAL ENGINEERS
1201 BROAD ST., SUITE 1-A
AUGUSTA, GA 30901
PH: (706) 724-3551
FAX: (706) 724-8507
EDC PROJECT #: 10051
http://www.edcaugusta.com
drawings@edcaugusta.com

SEALS

SOUTH CAROLINA REGISTERED PROFESSIONAL ENGINEER MICHAEL V. PAULK, JR. 1% 5-12

SOUTH CAROLINA ELECTRICAL DESIGN CONSULTANTS, INC. No. C01139 CERTIFICATE OF AUTHORIZATION

AIKEN COUNTY GOVERNMENT COMPLEX

AIKEN, SOUTH CAROLINA

REVISIONS:

NO.	DATE	DESCRIPTION	BY
1	2.21.12	PRELIMINARY REVIEW PACKAGE	EDC
2	5.1.12	DESIGN DEVELOPMENT PACKAGE	EDC
3.	7.20.12	50% CONSTRUCTION DOCUMENTS	EDC
4.			
5.	8.27.12	ISSUED FOR CONSTRUCTION	EDC
6.	11.5.12	CODE AND DEPARTMENT REVIEW COMMENTS	EDC
7.	3.15.13	DEPARTMENT REVIEW CHANGES	EDC

PRINCIPAL IN CHARGE: M. Paulk III
PROJECT MANAGER: K. Holt
DRAWN BY:

SHEET TITLE:
POWER PLAN - FIRST FLOOR - PART B

SHEET NO. E2.1B

PROJ. NO. 10033.02

ALL DRAWINGS, SPECIFICATIONS AND COPIES THEREOF FURNISHED BY HOWLAN KAZIAN WITH ARCHITECTURE ARE AND SHALL REMAIN THE PROPERTY OF HOWLAN KAZIAN WITH ARCHITECTURE. THESE MATERIALS ARE TO BE USED ONLY WITH RESPECT TO THIS PROJECT AND NOT TO BE USED WITH ANY OTHER PROJECT, WITH THE EXCEPTION OF ONE CONTRACT SET FOR EACH PARTY TO THE CONTRACT. SUCH DOCUMENTS ARE TO BE RETURNED OR DESTROYED IN ACCORDANCE THEREWITH. ALL REPRODUCTIONS, ALTERATIONS, ADDITIONS OR ANY OTHER USE OF THESE DOCUMENTS WITHOUT THE WRITTEN CONSENT OF HOWLAN KAZIAN WITH ARCHITECTURE IS PROHIBITED.

1 LIGHTING PLAN - SECOND FLOOR - PART A
E2.2A SCALE: 1/8"=1'-0"

GENERAL NOTES:

1. ALL 2'x4' FIXTURES SHALL BE TYPE "AD" UNLESS OTHERWISE NOTED. PROVIDE TWO SWITCHLEG CONDUCTORS TO DUAL INPUT BALLAST AT FIXTURE AS INDICATED BY OR
2. ALL DOWNLIGHTS TO BE TYPE "D" UNLESS OTHERWISE NOTED. WHERE SHOWN IN SPACE WITH DIMMER, ALL DOWNLIGHTS TO BE CONTROLLED VIA DIMMER SWITCH ONLY.
3. OCCUPANCY SENSORS SHALL CONTROL ALL FIXTURES WITHIN SAME ROOM/CORRIDOR AS SENSOR. ALL SENSORS TO BE LINE VOLTAGE SENSORS ONLY. SEE MANUFACTUERS INSTALLATION GUIDELINES FOR LOCATIONS WHERE MULTIPLE SENSORS CONTROL SAME LIGHT FIXTURE CIRCUIT/LOAD.
4. PROVIDE UNSWITCHED PHASE CONDUCTOR(HOT) TO ALL EXIT SIGNS AND TYPE "E" FIXTURES. DO NOT ROUTE THROUGH RELAY PANEL OR ON LOAD SIDE OF EMERGENCY RELAY.
5. LV MINIMUM 4-BUTTON LOW VOLTAGE LIGHTING CONTROL SWITCH. PROVIDE LOW VOTLAGE CABLIG TO RELAY PANEL LOCATED ON THIS FLOOR. SEE SCHEDULE SHEET FOR BUTTON OPERATION INSTALLATION REQUIREMENTS

KEYED NOTES:

1. "NORMAL" LIGHTING SWITCHED, EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 1/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
2. "BYPASS / OVERRIDE", EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 2/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
3. "DUAL LEVEL - NORMAL" LIGHTING SWITCHED, EMERGENCY LIGHTING CONTROL UNITS. SEE DETAIL 3/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
4. HOMERUN FOR CIRCUIT SERVING THIS AREA. PROVIDE CONDUCTOR WIRING TO ALL SPACES WITH LIGHT FIXTURES OF MATCHING CIRCUIT HOMERUN DESIGNATION. PROVIDE UNWITCHED CONDUCTOR FOR INDEPENDENT SPACE CONTROL BY DEVICE AS SHOWN IN EACH SPACE.
5. PROVIDE AND INSTALL THREE(3) 0-10V CAPABLE WALL MOUNTED DIMMERS AT 46" AFF. ONE(1) DIMMER TO CONTROL TYPE "DW" FIXTURES IN CENTRAL HALL, ONE(1) DIMMER TO CONTROL TYPE "DW" FIXTURES IN NORTH HALL, AND ONE(1) DIMMER TO CONTROL TYPE "DW" FIXTURES IN SOUTH HALL.

ELECTRICAL DESIGN CONSULTANTS INC.
ELECTRICAL ENGINEERS
1201 BROAD ST., SUITE 1-A
AUGUSTA, GA 30901
PH: (706) 724-3551
FAX: (706) 724-8507
EDC PROJECT #: 10051
http://www.edcaugusta.com
drawings@edcaugusta.com

SEALS

SOUTH CAROLINA PROFESSIONAL ENGINEER M. PAULK III 12-5-12

SOUTH CAROLINA ELECTRICAL DESIGN CONSULTANTS, INC. No. C01139 CERTIFICATE OF AUTHORIZATION

AIKEN COUNTY GOVERNMENT COMPLEX

AIKEN, SOUTH CAROLINA

REVISIONS:

NO.	DATE	DESCRIPTION	BY
1	2.21.12	PRELIMINARY REVIEW PACKAGE	EDC
2	5.1.12	DESIGN DEVELOPMENT PACKAGE	EDC
3.	7.20.12	50% CONSTRUCTION DOCUMENTS	EDC
4.			
5.	8.27.12	ISSUED FOR CONSTRUCTION	EDC
6.	11.5.12	CODE AND DEPARTMENT REVIEW COMMENTS	EDC
7.	3.15.13	DEPARTMENT REVIEW CHANGES	EDC

PRINCIPAL IN CHARGE: M. Paulk III
PROJECT MANAGER: K. Holt
DRAWN BY:

SHEET TITLE:
LIGHTING PLAN - SECOND FLOOR - PART A

SHEET NO. E2.2A

PROJ. NO. 10033.02


KEY PLAN

ALL DRAWINGS, SPECIFICATIONS AND CORES THEREOF FURNISHED BY HONEYCUTT PRODUCTIONS, INC. ARE THE PROPERTY OF HONEYCUTT PRODUCTIONS, INC. AND SHALL REMAIN THE PROPERTY OF HONEYCUTT PRODUCTIONS, INC. THEY ARE TO BE USED ONLY WITH RESPECT TO THIS PROJECT AND NOT TO BE USED WITH ANY OTHER PROJECT, WITH THE EXCEPTION OF ONE CONTRACT SET FOR EACH PARTY TO THE CONTRACT. SUCH DOCUMENTS ARE TO BE RETURNED OR DESTROYED IN ACCORDANCE WITH THE ARCHITECT'S INSTRUCTIONS. THESE MATERIALS ARE TO BE USED ONLY WITH RESPECT TO THIS PROJECT AND NOT TO BE USED WITH ANY OTHER PROJECT, WITH THE EXCEPTION OF ONE CONTRACT SET FOR EACH PARTY TO THE CONTRACT. SUCH DOCUMENTS ARE TO BE RETURNED OR DESTROYED IN ACCORDANCE WITH THE ARCHITECT'S INSTRUCTIONS. THESE MATERIALS ARE THE PROPERTY OF HOLLAN FRZDAR SMITH ARCHITECTURE, INC. AND SHALL REMAIN THE PROPERTY OF HOLLAN FRZDAR SMITH ARCHITECTURE, INC. THEY ARE TO BE USED ONLY WITH RESPECT TO THIS PROJECT AND NOT TO BE USED WITH ANY OTHER PROJECT, WITH THE EXCEPTION OF ONE CONTRACT SET FOR EACH PARTY TO THE CONTRACT. SUCH DOCUMENTS ARE TO BE RETURNED OR DESTROYED IN ACCORDANCE WITH THE ARCHITECT'S INSTRUCTIONS. ORIGINALS ARE PROFESSIONAL ARCHITECTURAL WORKS OF ART. ALL RIGHTS RESERVED.

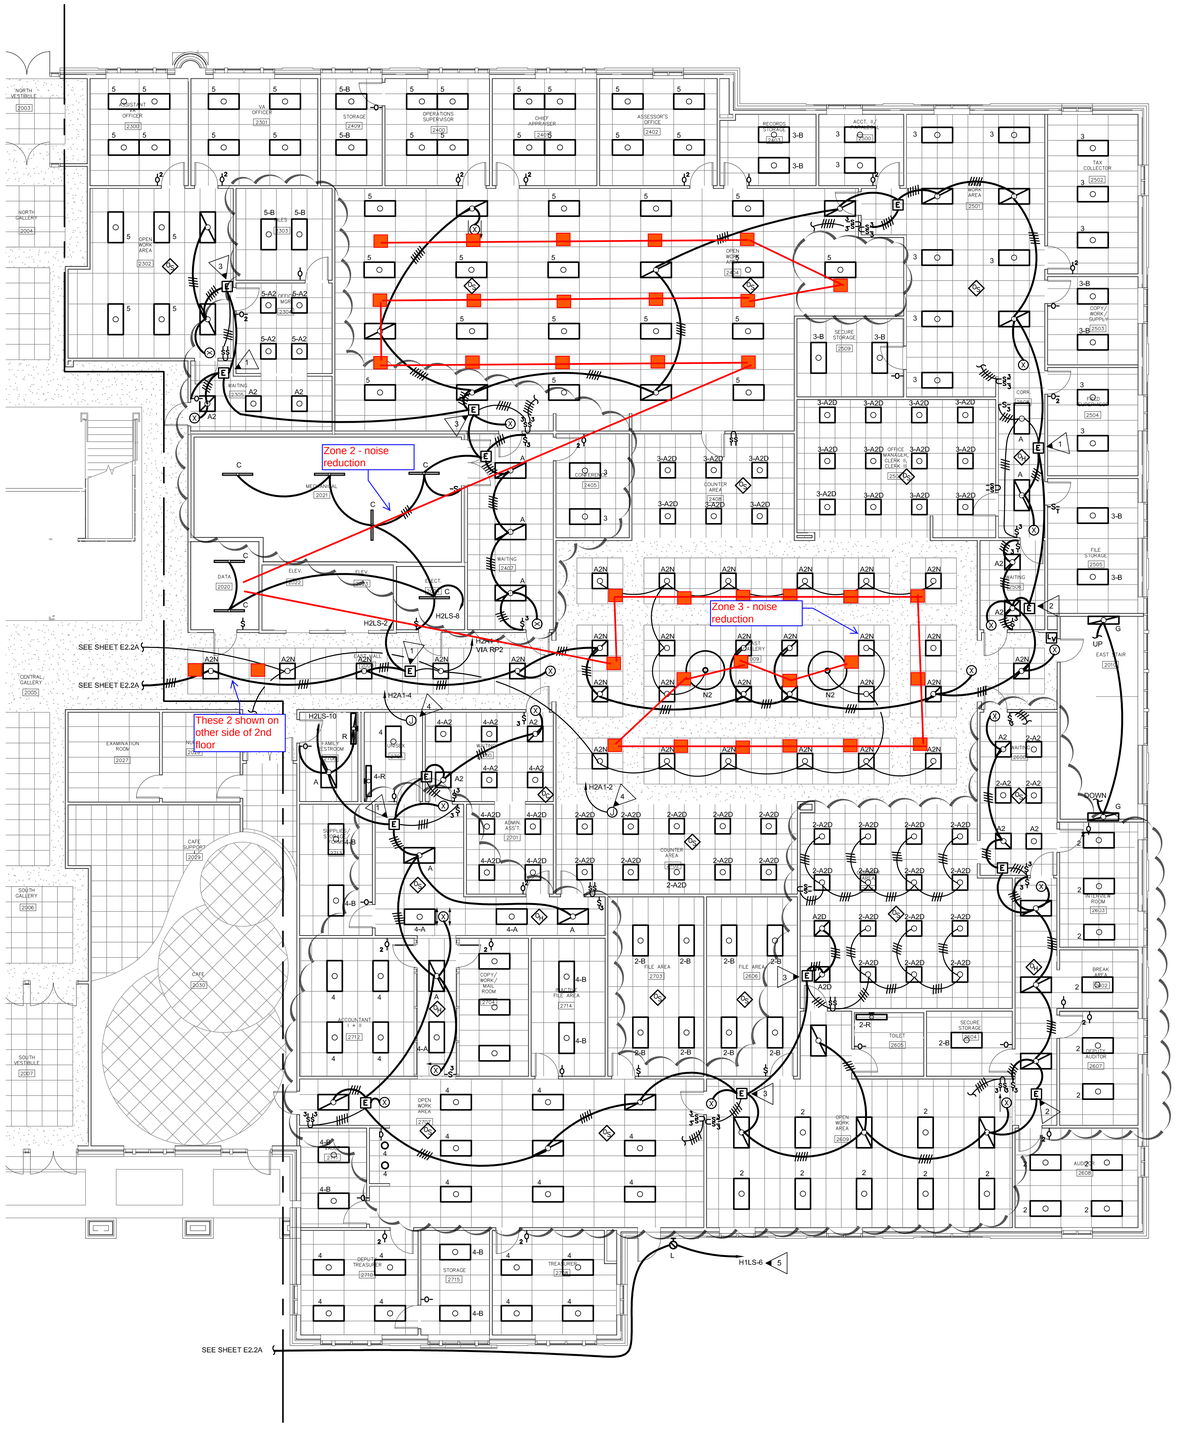

1 LIGHTING PLAN - SECOND FLOOR - PART B
E2.2B
SCALE: 1/8"=1'-0"

GENERAL NOTES:

1. ALL 2'x4' FIXTURES SHALL BE TYPE "AD" UNLESS OTHERWISE NOTED. PROVIDE TWO SWITCHLEG CONDUCTORS TO DUAL INPUT BALLAST AT FIXTURE AS INDICATED BY OR
2. ALL DOWNLIGHTS TO BE TYPE "D" UNLESS OTHERWISE NOTED. WHERE SHOWN IN SPACE WITH DIMMER, ALL DOWNLIGHTS TO BE CONTROLLED VIA DIMMER SWITCH ONLY.
3. OCCUPANCY SENSORS SHALL CONTROL ALL FIXTURES WITHIN SAME ROOM/CORRIDOR AS SENSOR. ALL SENSORS TO BE LINE VOLTAGE SENSORS ONLY. SEE MANUFACTUER'S INSTALLATION GUIDELINES FOR LOCATIONS WHERE MULTIPLE SENSORS CONTROL SAME LIGHT FIXTURE CIRCUIT/LOAD.
4. PROVIDE UNSWITCHED PHASE CONDUCTOR(HOT) TO ALL EXIT SIGNS AND TYPE "E" FIXTURES. DO NOT ROUTE THROUGH RELAY PANEL OR ON LOAD SIDE OF EMERGENCY RELAY.
5. LV MINIMUM 4-BUTTON LOW VOLTAGE LIGHTING CONTROL SWITCH. PROVIDE LOW VOLTAGE CABLIG TO RELAY PANEL LOCATED ON THIS FLOOR. SEE SCHEDULE SHEET FOR BUTTON OPERATION INSTALLATION REQUIREMENTS

KEYED NOTES:

1. "NORMAL" LIGHTING SWITCHED, EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 1/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
2. "BYPASS / OVERRIDE", EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 2/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
3. "DUAL LEVEL - NORMAL" LIGHTING SWITCHED, EMERGENCY LIGHTING CONTROL UNITS. SEE DETAIL 3/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
4. HOMERUN FOR CIRCUIT SERVING THIS AREA. PROVIDE CONDUCTOR WIRING TO ALL SPACES WITH LIGHT FIXTURES OF MATCHING CIRCUIT HOMERUN DESIGNATION. PROVIDE UNWITCHED CONDUCTOR FOR INDEPENDENT SPACE CONTROL BY DEVICE AS SHOWN IN EACH SPACE.
5. ROUTE TO CIRCUIT AS SHOWN VIA "BYPASS / OVERRIDE". EMERGENCY LIGHTING CONTROL UNIT TO BE LOCATED AT PANEL. EMERGENCY LIGHTING CONTROL UNIT TO BE OPERATED BY PANEL "RPS. SEE DETAIL 4/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.

KEY PLAN

ELECTRICAL DESIGN CONSULTANTS INC.
ELECTRICAL ENGINEERS
1201 BROAD ST., SUITE 1-A
AUGUSTA, GA 30901
PH: (706) 724-3551
FAX: (706) 724-8507
EDC PROJECT #: 10051
http://www.edcaugusta.com
drawings@edcaugusta.com

SEALS

SOUTH CAROLINA REGISTERED PROFESSIONAL ENGINEER M. PAULK III 12-5-12

SOUTH CAROLINA ELECTRICAL DESIGN CONSULTANTS, INC. No. C01139 CERTIFICATE OF AUTHORIZATION

AIKEN COUNTY GOVERNMENT COMPLEX

AIKEN, SOUTH CAROLINA

REVISIONS:

NO.	DATE	DESCRIPTION	BY
1	2.21.12	PRELIMINARY REVIEW PACKAGE	EDC
2	5.1.12	DESIGN DEVELOPMENT PACKAGE	EDC
3.	7.20.12	50% CONSTRUCTION DOCUMENTS	EDC
4.			
5.	8.27.12	ISSUED FOR CONSTRUCTION	EDC
6.	11.5.12	CODE AND DEPARTMENT REVIEW COMMENTS	EDC

PRINCIPAL IN CHARGE: M. Paulk III
PROJECT MANAGER: K. Holt
DRAWN BY:

SHEET TITLE:

LIGHTING PLAN - SECOND FLOOR - PART B

SHEET NO. E2.2B

PROJ. NO. 10033.02

ALL DRAWINGS, SPECIFICATIONS AND COPIES THEREOF FURNISHED BY MCMILLAN PAZDAN SMITH ARCHITECTURE ARE AND SHALL REMAIN THE PROPERTY OF MCMILLAN PAZDAN SMITH ARCHITECTURE. THEY ARE NOT TO BE USED WITH ANY OTHER PROJECT, WITH THE EXCEPTION OF ONE CONTRACT SET FOR EACH PARTY TO THE CONTRACT. SUCH DOCUMENTS ARE TO BE RETURNED OR DESTROYED IN ACCORDANCE WITH THE ARCHITECT'S ESTABLISHED PROCEDURES. ALL REPRODUCTIONS, COPIES OR ADDITIONS TO THESE DRAWINGS, SPECIFICATIONS AND COPIES THEREOF FURNISHED BY MCMILLAN PAZDAN SMITH ARCHITECTURE, OR ANY PART THEREOF, WITHOUT WRITTEN PERMISSION OF MCMILLAN PAZDAN SMITH ARCHITECTURE, ARE PROHIBITED. ALL RIGHTS RESERVED.

Location of QTemitter

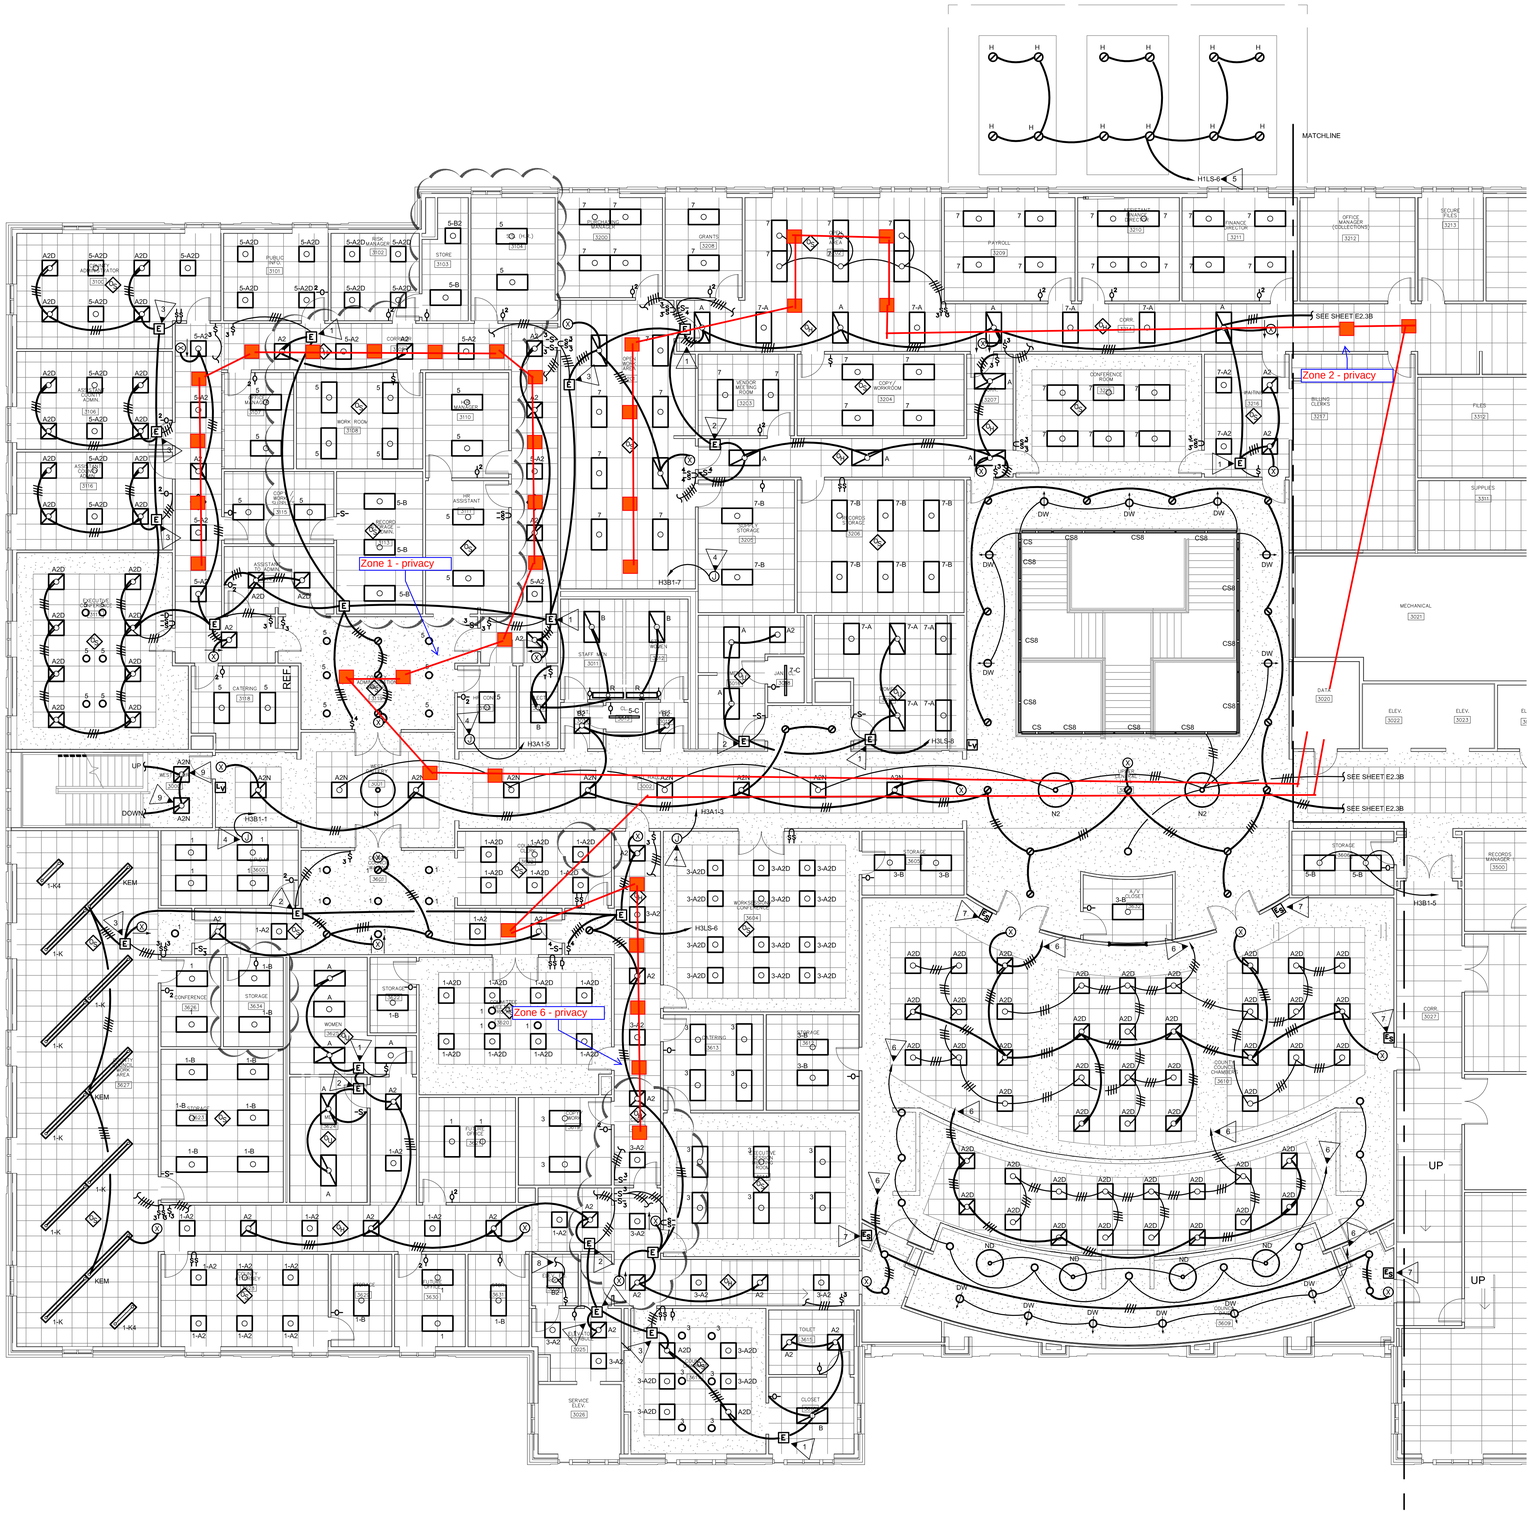

1 LIGHTING PLAN - THIRD FLOOR - PART A
E2.3B SCALE: 1/8"=1'-0"

GENERAL NOTES:

1. ALL 2'x4' FIXTURES SHALL BE TYPE "AD" UNLESS OTHERWISE NOTED. PROVIDE TWO SWITCHLEG CONDUCTORS TO DUAL INPUT BALLAST AT FIXTURE AS INDICATED BY OR
2. ALL DOWNLIGHTS TO BE TYPE "D" UNLESS OTHERWISE NOTED. WHERE SHOWN IN SPACE WITH DIMMER, ALL DOWNLIGHTS TO BE CONTROLLED VIA DIMMER SWITCH ONLY.
3. OCCUPANCY SENSORS SHALL CONTROL ALL FIXTURES WITHIN SAME ROOM/CORRIDOR AS SENSOR. ALL SENSORS TO BE LINE VOLTAGE SENSORS ONLY. SEE MANUFACTUER'S INSTALLATION GUIDELINES FOR LOCATIONS WHERE MULTIPLE SENSORS CONTROL SAME LIGHT FIXTURE CIRCUIT/LOAD.
4. PROVIDE UNSWITCHED PHASE CONDUCTOR(HOT) TO ALL EXIT SIGNS AND TYPE "E" FIXTURES. DO NOT ROUTE THROUGH RELAY PANEL OR ON LOAD SIDE OF EMERGENCY RELAY.
5. LV MINIMUM 4-BUTTON LOW VOLTAGE LIGHTING CONTROL SWITCH. PROVIDE LOW VOTLAGE CABLIG TO RELAY PANEL LOCATED ON THIS FLOOR. SEE SCHEDULE SHEET FOR BUTTON OPERATION INSTALLATION REQUIREMENTS

KEYED NOTES:

1. "NORMAL" LIGHTING SWITCHED, EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 1/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
2. "BYPASS / OVERRIDE", EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 2/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
3. "DUAL LEVEL - NORMAL" LIGHTING SWITCHED, EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 3/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
4. HOMERUN FOR CIRCUIT SERVING THIS AREA. PROVIDE CONDUCTOR WIRING TO ALL SPACES WITH LIGHT FIXTURES OF MATCHING CIRCUIT HOMERUN DESIGNATION. PROVIDE UNWITCHED CONDUCTOR FOR INDEPENDENT SPACE CONTROL BY DEVICE AS SHOWN IN EACH SPACE.
5. ROUTE TO CIRCUIT AS SHOWN VIA "BYPASS / OVERRIDE", EMERGENCY LIGHTING CONTROL UNIT TO BE LOCATED AT PANEL. EMERGENCY LIGHTING CONTROL UNIT TO BE OPERATED BY PANEL "RPS. SEE DETAIL 4/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
6. ROUTE CIRCUIT TO LIGHTING CONTROLLER UNIT LOCATED IN A/V EQUIPMENT CLOSET. SEE E3.3A FOR LOCATION. SEE CONTROLLER SCHEDULE BELOW FOR OPERATION AND CONTROL REQUIREMENTS.
7. SINGLE GANG BOX AT 46" AFF FOR 4-BUTTON LOW VOLTAGE ENTRY STATION BUTTON WITH RAISE/LOWER CAPABILITIES. ENTRY STATION TO BE ILUMIN "INEO #CLS-4TSB-RL-W" SERIES, SEE CONTROLLER SCHEDULE BELOW FOR OPERATION AND CONTROL REQUIREMENTS.
8. CONNECT TO LOAD SIDE OF GFCI OULET IN SPACE. SEE SHEET E3.3A FOR CONTINUATION.
9. PROVIDE FLANGE MOUNT TRIM MOUNTING KIT FOR FIXTURE.

COUNCIL CHAMBERS CONTROLLER SCHEDULE

TERMINAL NO. & TYPE		LIGHTING CONTROLLED (AREA)
1	DIMMER	TYPE "D" DOWNLIGHTS
2	DIMMER	TYPE "D" EMERGENCY DOWNLIGHTS
3	DIMMER	TYPE "DW" DOWNLIGHTS
4	DIMMER	TYPE "ND" PENDANTS
5	ON / OFF	TYPE "A2D" FRONT (BALLAST INPUT 1)
6	ON / OFF	TYPE "A2D" FRONT (BALLAST INPUT 2)
7	ON / OFF	TYPE "A2D" FRONT EMER. (BALLAST INPUT 1)
8	ON / OFF	TYPE "A2D" FRONT EMER. (BALLAST INPUT 2)
9	ON / OFF	TYPE "A2D" SEATING (BALLAST INPUT 1)
10	ON / OFF	TYPE "A2D" SEATING (BALLAST INPUT 2)
11	ON / OFF	TYPE "A2D" SEATING EMER. (BALLAST INPUT 1)
12	ON / OFF	TYPE "A2D" SEATING EMER. (BALLAST INPUT 2)

REMARKS:
–



ELECTRICAL DESIGN CONSULTANTS, INC.
ELECTRICAL ENGINEERS
1201 BROAD ST., SUITE 1-A
AUGUSTA, GA 30901
PH: (706) 724-3551
FAX: (706) 724-8507
EDC PROJECT #: 10051
http://www.edcaugusta.com
drawings@edcaugusta.com

SEALS

SOUTH CAROLINA PROFESSIONAL ENGINEER MICHAEL J. PAULK, III 17676 1-5-12

SOUTH CAROLINA ELECTRICAL DESIGN CONSULTANTS, INC. No. C01139 CERTIFICATE OF AUTHORIZATION

AIKEN COUNTY GOVERNMENT COMPLEX

AIKEN, SOUTH CAROLINA

REVISIONS:

NO.	DATE	DESCRIPTION	BY
1	2.21.12	PRELIMINARY REVIEW PACKAGE	EDC
2	5.1.12	DESIGN DEVELOPMENT PACKAGE	EDC
3.	7.20.12	50% CONSTRUCTION DOCUMENTS	EDC
4.			
5.	8.27.12	ISSUED FOR CONSTRUCTION	EDC
6.	11.5.12	CODE AND DEPARTMENT REVIEW COMMENTS	EDC
7.	3.15.13	DEPARTMENT REVIEW CHANGES	EDC

PRINCIPAL IN CHARGE: M. Paulk III
PROJECT MANAGER: K. Holt
DRAWN BY:

SHEET TITLE:
LIGHTING PLAN - THIRD FLOOR - PART B

SHEET NO. E2.3A

PROJ. NO. 10033.02

ALL DRAWINGS, SPECIFICATIONS AND COPIES THEREOF FURNISHED BY MCMILLAN PAZDAN SMITH ARCHITECTURE ARE AND SHALL REMAIN THE PROPERTY OF MCMILLAN PAZDAN SMITH ARCHITECTURE. THESE MATERIAL ARE TO BE USED ONLY WITH RESPECT TO THIS PROJECT, WITH THE EXCEPTION OF ONE CONTRACT SET FOR EACH PARTY TO THE CONTRACT. SUCH DOCUMENTS ARE TO BE RETURNED OR DESTROYED IN ACCORDANCE WITH THE PROFESSIONAL SERVICES AGREEMENT. ALL REPRODUCTIONS, ALTERATIONS, ADDITIONS OR ALTERNATIVE USES OF THESE DOCUMENTS WITHOUT WRITTEN PERMISSION OF MCMILLAN PAZDAN SMITH ARCHITECTURE ARE PROHIBITED.

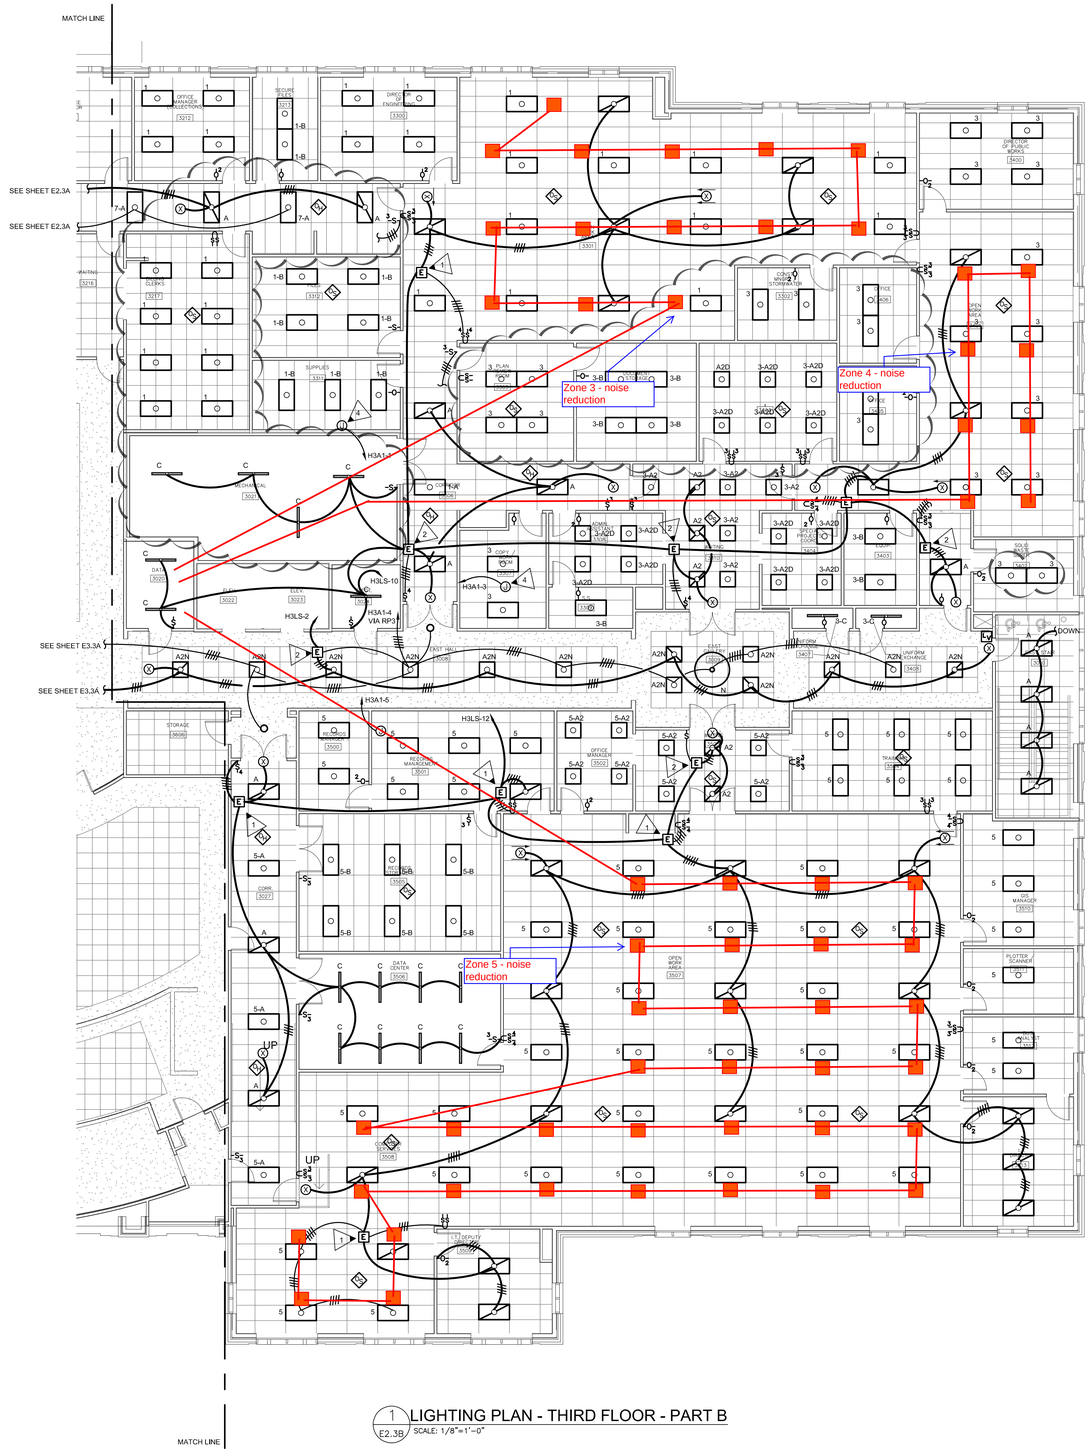

1 E2.3B LIGHTING PLAN - THIRD FLOOR - PART B
SCALE: 1/8"=1'-0"

GENERAL NOTES:

1. ALL 2'x4' FIXTURES SHALL BE TYPE "AD" UNLESS OTHERWISE NOTED. PROVIDE TWO SWITCHLEG CONDUCTORS TO DUAL INPUT BALLAST AT FIXTURE AS INDICATED BY OR
2. ALL DOWNLIGHTS TO BE TYPE "D" UNLESS OTHERWISE NOTED. WHERE SHOWN IN SPACE WITH DIMMER, ALL DOWNLIGHTS TO BE CONTROLLED VIA DIMMER SWITCH ONLY.
3. OCCUPANCY SENSORS SHALL CONTROL ALL FIXTURES WITHIN SAME ROOM/CORRIDOR AS SENSOR. ALL SENSORS TO BE LINE VOLTAGE SENSORS ONLY. SEE MANUFACTUER'S INSTALLATION GUIDELINES FOR LOCATIONS WHERE MULTIPLE SENSORS CONTROL SAME LIGHT FIXTURE CIRCUIT/LOAD.
4. PROVIDE UNSWITCHED PHASE CONDUCTOR(HOT) TO ALL EXIT SIGNS AND TYPE "E" FIXTURES. DO NOT ROUTE THROUGH RELAY PANEL OR ON LOAD SIDE OF EMERGENCY RELAY.
5. LV MINIMUM 4-BUTTON LOW VOLTAGE LIGHTING CONTROL SWITCH. PROVIDE LOW VOTLAGE CABLIG TO RELAY PANEL LOCATED ON THIS FLOOR. SEE SCHEDULE SHEET FOR BUTTON OPERATION INSTALLATION REQUIREMENTS

KEYED NOTES:

1. "NORMAL" LIGHTING SWITCHED, EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 1/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
2. "BYPASS / OVERRIDE", EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 2/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
3. "DUAL LEVEL - NORMAL" LIGHTING SWITCHED, EMERGENCY LIGHTING CONTROL UNIT. SEE DETAIL 3/E9.1 INSTALLATION REQUIREMENTS AND OPERATION.
4. HOMERUN FOR CIRCUIT SERVING THIS AREA. PROVIDE CONDUCTOR WIRING TO ALL SPACES WITH LIGHT FIXTURES OF MATCHING CIRCUIT HOMERUN DESIGNATION. PROVIDE UNWITCHED CONDUCTOR FOR INDEPENDENT SPACE CONTROL BY DEVICE AS SHOWN IN EACH SPACE.



KEY PLAN

ELECTRICAL DESIGN CONSULTANTS INC.
ELECTRICAL ENGINEERS
1201 BROAD ST., SUITE 1-A
AUGUSTA, GA 30901
PH: (706) 724-3551
FAX: (706) 724-8507
EDC PROJECT #: 10051
http://www.edcaugusta.com
drawings@edcaugusta.com

SEALS

AIKEN COUNTY GOVERNMENT COMPLEX

AIKEN, SOUTH CAROLINA

REVISIONS:

NO.	DATE	DESCRIPTION	BY
1	2.21.12	PRELIMINARY REVIEW PACKAGE	EDC
2	5.1.12	DESIGN DEVELOPMENT PACKAGE	EDC
3.	7.20.12	50% CONSTRUCTION DOCUMENTS	EDC
4.			
5.	8.27.12	ISSUED FOR CONSTRUCTION	EDC
6.	11.5.12	CODE AND DEPARTMENT REVIEW COMMENTS	EDC

PRINCIPAL IN CHARGE: M. Paulk III
PROJECT MANAGER: K. Holt
DRAWN BY:

SHEET TITLE:
LIGHTING PLAN - THIRD FLOOR - PART B

SHEET NO. E2.3B
PROJ. NO. 10033.02

ALL DRAWINGS, SPECIFICATIONS AND COPIES THEREOF FURNISHED BY MCMILLAN PAZDAN SMITH ARCHITECTURE ARE AND SHALL REMAIN THE PROPERTY OF MCMILLAN PAZDAN SMITH ARCHITECTURE. THESE MATERIALS ARE TO BE USED ONLY WITH RESPECT TO THIS PROJECT AND NOT TO BE USED WITH ANY OTHER PROJECT, WITH THE EXCEPTION OF ONE CONTRACT SET FOR EACH PARTY TO THE CONTRACT. SUCH DOCUMENTS ARE TO BE RETURNED OR DESTROYED IN ACCORDANCE WITH RESPECT TO THIS PROJECT. ALL REPRODUCTIONS, ALTERATIONS, ADDITIONS OR ALTERATIONS TO THESE DRAWINGS, SPECIFICATIONS AND COPIES THEREOF, WITHOUT WRITTEN PERMISSION OF MCMILLAN PAZDAN SMITH ARCHITECTURE, ARE PROHIBITED.